

## CASING

Steel casing is covered with high quality multilayer aluminium and zinc alloy to prevent corrosion. The casing is equipped with a switch to turn the ventilator off when the service panel is opened. Service access from both left and right side. For outdoor installation the roof is necessary (optional).

## HEAT RECOVERY CORE

Unique plate heat exchanger is made of polystyrene and designed for high-efficient heat recovery. The stainless steel drain pan is located on the inlet and outlet sides.

## FANS

The unit is equipped with supply and exhaust centrifugal fans with backward curved blades and built-in thermal overheating protection with automatic restart. The electric motors and impellers are dynamically balanced.

## DEFROST SYSTEM

Fan stop defrost system is activated when the outdoor temperature falls below 23° F (-5° C).

## FILTER

Washable MERV 6 air filters in exhaust and supply air streams. Filters MERV 8, MERV 13 optional.

HRV 25

Additional Air Pressure Drop with optional filters		
Filter type	Airflow CFM	
	1000	1400
MERV 8	0.04	0.06
MERV 13	0.25	0.35

## CONTROL



The unit incorporates an integrated automation and control system with following functions:

- Operation mode switch.
- Airflow balancing by supply and exhaust fan independent speed adjustment.
- Automatic recovery core frost protection.
- External control device connection.





## DIMENSIONS

Measurements [in]					
A	A2	H	H2	H3	L
49"	30"	26"	8"	4"	36 1/2"

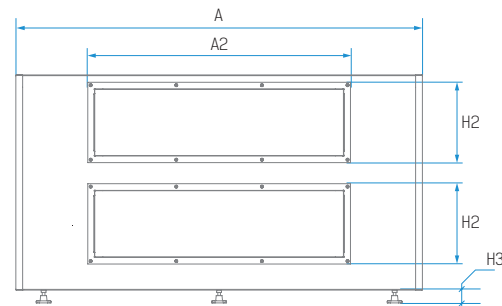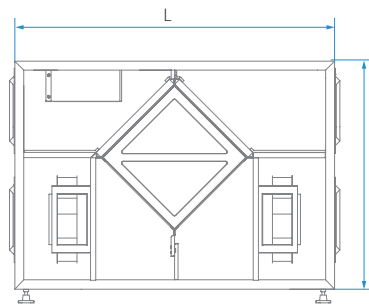

**TECHNICAL DATA**

Parameters	AIRLITE HRV 25
Voltage [V / 60 Hz]	1 ~ 120
Unit power [W]	2010
Unit current [A]	16.9
Minimum circuit Amps [MCA]	21.2
Maximum over current protection [MOP]	20.5
Sensible effectiveness @ max airflow [%]	55
Air flow @ ESP 0.4" WG [cfm]	1600
Air flow max [cfm]	1785
Transported air temperature [F]	-35 up to +140
Outer skin casing material	21 gauge galvanized steel
Insulation	1" mineral wool
Connected air duct size [in]	8×30

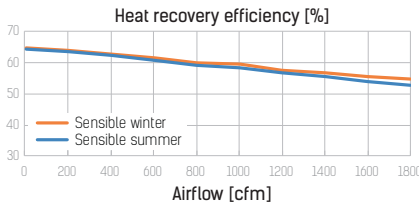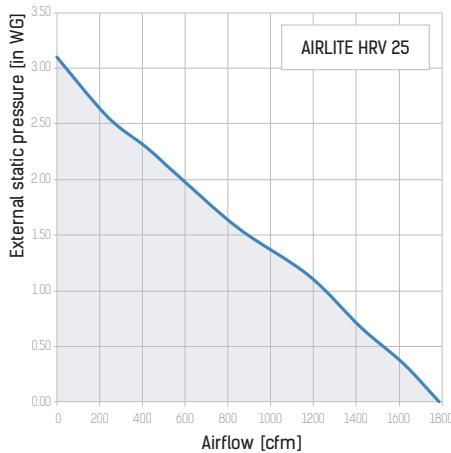

Acoustic Noise Power Chart (dBA) at unit ports		
Airflow	Fresh air to building port	Exhaust air from building port
1600 CFM at 0.4 in. w.g.	79 dBA	79 dBA
640 CFM at 0.2 in. w.g.	61 dBA	61 dBA

MODEL	QUANTITY	COMMENTS	PROJECT
			location:
			architect:
			engineer:
			contractor:
			submitted by: